


ARMENIA 250 MW COMBINED-CYCLE POWER PLANT

Armenia 
250 MW CCGT

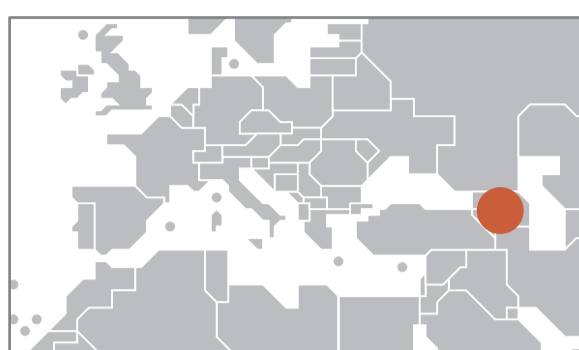

Expected Gross
Electrical power Output

253,7
MW

Expected Gross
Efficiency

54,3%

Plant's useful life

25/30
years

Construction period

26
months



Supplier
Power Island

Siemens


256,1
mil di \$

Estimated project cost
(inc. contingency)

EPC
Contractor

Renco Spa

The project structure

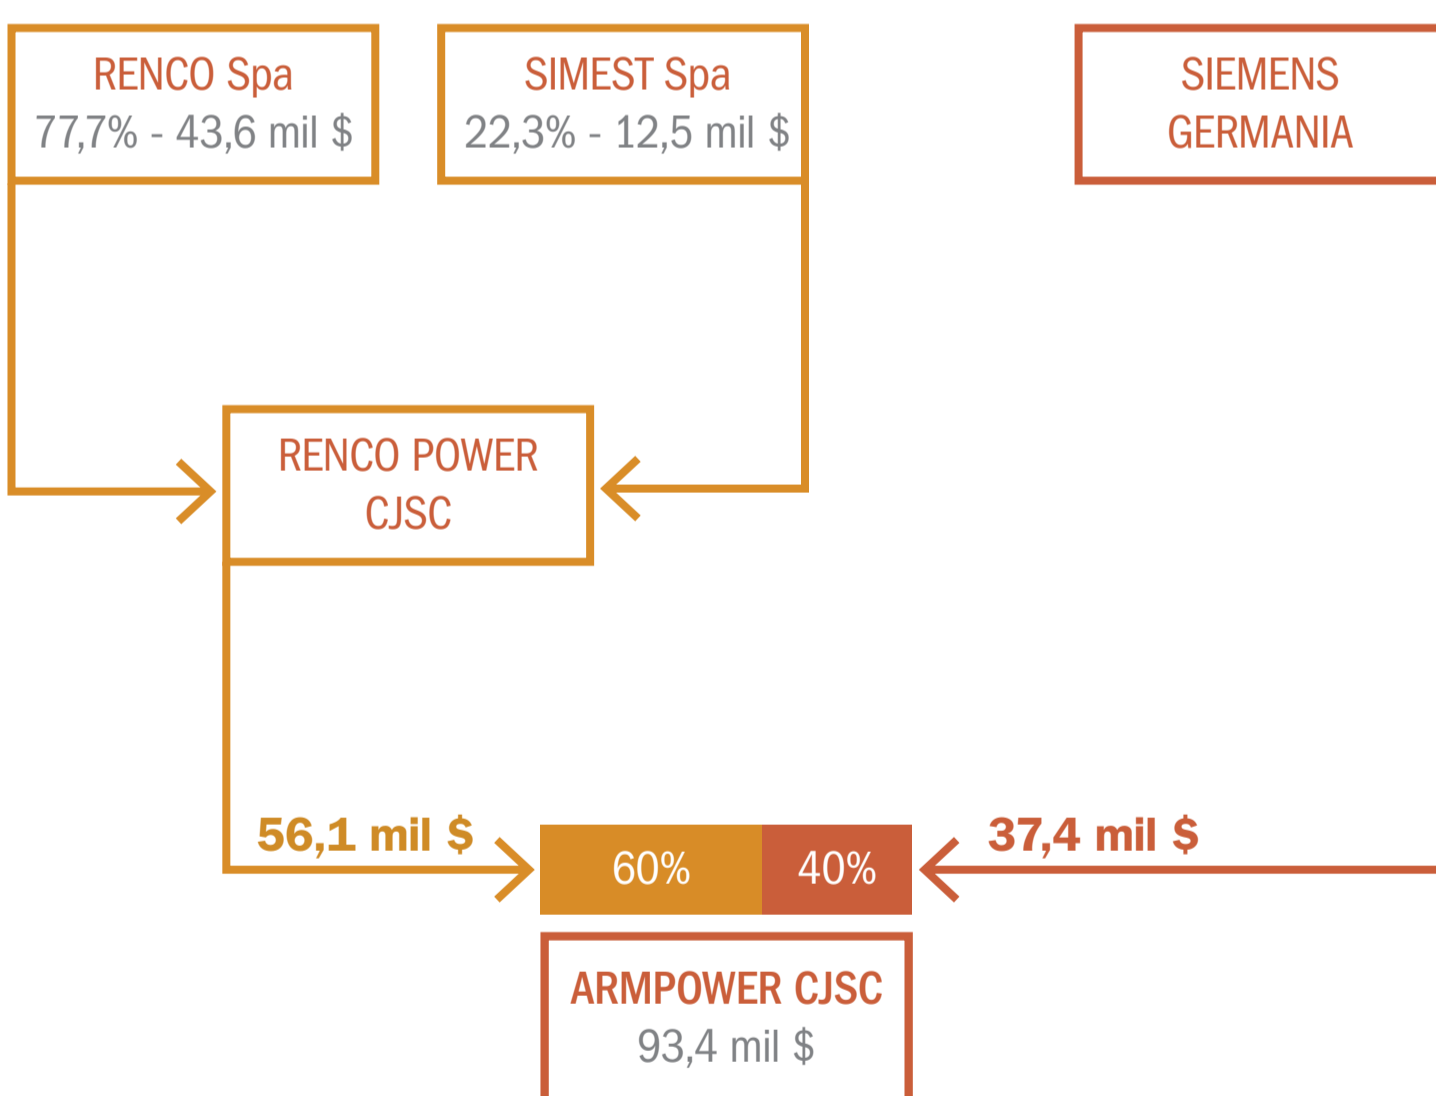

Who we are




Pesaro
Main Office

4,000
people

Staff
from around
the world

248,7
mil €

Production
value of 2017

Our business



Energy

EPC, services,
power production



Buildings

Development, construction,
property management